


Certificate of Compliance

Certificate Number R25977-20090106
Report Reference November 26, 2008
Issue Date 2009 January 6

Page 1 of 2

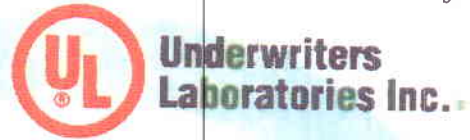

Issued to: Plásticos Espumados S A DE C V

Carr Tula *** Jorobas Km 24.5 Llano De Ixtazacuala
San Jeronimo *** 42970 Tlamanca Atitalaquia, Hgo Mexico

*This is to certify that
representative samples of*


Foamed Plastic
Designated Insufom. (Also see addendum page 2)

*Have been investigated by Underwriters Laboratories Inc.® in accordance
with the Standard(s) indicated on this Certificate.*

Standard(s) for Safety: ANSI/UL723: "Test for Surface Burning Characteristics of Building Materials."

Additional Information: The product is intended for use as a building material as permitted by
authorities having jurisdiction.

Only those products bearing the UL Classification Mark should be considered as being
covered by UL's Classification and Follow-Up Service.

The UL Classification Mark includes: UL in a circle symbol:  with the word
"CLASSIFIED" (as shown); a control number (may be alphanumeric) assigned by UL; a
statement to indicate the extent of UL's evaluation of the product; and, the product category
name (product identity) as indicated in the appropriate UL Directory.

Look for the UL Classification Mark on the product

Issued by:

Tracey J. Milton
Underwriters Laboratories Inc.

Reviewed by:


James F. Smith
Underwriters Laboratories Inc.

A handwritten signature in black ink, appearing to read 'James F. Smith', with a stylized flourish at the end.

Certificate of Compliance

Certificate Number R25977-20090106
Report Reference November 26, 2008
Issue Date 2009 January 6

Page 2 of 2

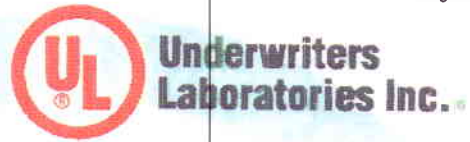

This is to verify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Foamed plastic in the form of blocks and boards. (*Report Date: 2008-11-26*)

	3 In. Max +
Flame spread	0#
Smoke developed	185-300#

- + Installed in a thickness or stored in an effective thickness, as indicated, for a density of 30.44 kg/cm³.
- # Flame spread and smoke developed recorded while material remained in original test position. Ignition of molten residue on the furnace floor resulted in flame travel equivalent to calculated flame spread of 140 and smoke developed index of over 500.

Issued by:

Tracey J. Milton
Underwriters Laboratories Inc.

A handwritten signature in black ink that reads 'Tracey J. Milton'.

Reviewed by:

James F. Smith
Underwriters Laboratories Inc.

A handwritten signature in black ink that reads 'James F. Smith' with a stylized flourish at the end.